

BUILDING SPECIFICATIONS:

THIS STRUCTURE HAS BEEN DESIGNED AND DETAILED FOR THE LOADS AND CONDITIONS SHOWN ON THESE DRAWINGS. ANY ALTERATIONS TO THE STRUCTURAL SYSTEM OR REMOVAL OF ANY COMPONENT PARTS OR THE ADDITION OF OTHER CONSTRUCTION MATERIALS OR LOADS MUST BE DONE UNDER THE ADVICE AND DIRECTION OF A REGISTERED ARCHITECT, CIVIL OR STRUCTURAL ENGINEER. EUROMEX'S MANUFACTURING & SALES WILL ASSUME NO RESPONSIBILITY FOR ANY LOADS NOT INDICATED.

THIS METAL BUILDING IS DESIGNED WITH EUROMEX'S MANUFACTURING & SALES DESIGN PRACTICES WHICH ARE BASED ON PERTINENT PROCEDURES AND RECOMMENDATIONS OF THE FOLLOWING ORGANIZATIONS AND CODES, AND ARE ACCEPTED PRACTICES IN THE LOW RISE METAL AND AGRICULTURAL BUILDING INDUSTRY.

AMERICAN INSTITUTE OF STEEL CONSTRUCTION:
"STEEL CONSTRUCTION MANUAL" 14TH EDITION.
2005 A.I.S.C. (M.B.M.A.) "SERVICEABILITY" STANDARDS WILL BE USED FOR THIS DESIGN.

AMERICAN IRON AND STEEL INSTITUTE:
2007 EDITION: NORTH AMERICAN SPECIFICATION FOR THE DESIGN OF COLD-FORMED STEEL STRUCTURAL MEMBERS.

INTERNATIONAL CONFERENCE OF BUILDING OFFICIALS:
OREGON STRUCTURAL SPECIALTY CODE, 2014 EDITION (2012 IBC)

AMERICAN WELDING SOCIETY:
"STRUCTURAL WELDING CODE" A.W.S D1.1-10

METAL BUILDING MANUFACTURER'S ASSOCIATION:
"METAL BUILDING SYSTEMS MANUAL" 2006

11/08/18
VECTOR PROJECT #: U3024-001-181
STRUCTURAL ONLY



651 W. GALENA PARK BLVD. STE. 101 DRAPER, UTAH 84020
PHONE (801) 990-1775
WWW.VECTORSSE.COM


CONCRETE NOTES:

- ALL CONCRETE SHALL WITHSTAND 4000 LBS. PER SQUARE INCH ULTIMATE COMPRESSIVE STRESS AT 28 DAYS.
- CONTRACTOR SHALL INFORM EUROMEX'S MANUFACTURING & SALES OF ANY DISCREPANCIES, OMISSIONS, OR ERRORS ON THE PLANS BEFORE BEGINNING CONSTRUCTION, OTHERWISE, IT SHALL BE DONE AS INTENDED BY THE ENGINEER.
- THE ENGINEER AND/OR EUROMEX'S MANUFACTURING & SALES ASSUMES NO RESPONSIBILITY FOR CONSTRUCTION SUPERVISION OR DEVIATION FROM THESE PLANS WITHOUT PRIOR WRITTEN APPROVAL.
- ALL CONSTRUCTION SHALL COMPLY WITH THE OREGON STRUCTURAL SPECIALTY CODE, 2014 EDITION (2012 IBC) AS AMENDED BY THE LOCAL AGENCY HAVING JURISDICTION.
- DO NOT SCALE DRAWINGS. WRITTEN DIMENSIONS ON DRAWINGS SHALL TAKE PRECEDENCE OVER SCALED DIMENSIONS.
- ANY ENGINEERING DESIGN PROVIDED BY OTHERS MUST BE SUBMITTED FOR REVIEW AND SHALL BEAR THE STAMP AND SIGNATURE OF A REGISTERED ENGINEER.
- ALL PLUMBING, ELECTRICAL OR MISCELLANEOUS STUB OUT SHALL BE A MINIMUM OF NINE (9) INCHES CLEAR OF THE OUTSIDE CONCRETE IN ORDER TO CLEAR THE WALLS.
- FOOTINGS SHALL BE CENTERED ON THE CENTERLINE OF THE COLUMN ABOVE UNLESS OTHERWISE NOTED.
- ALL FOOTINGS SHALL BEAR AGAINST FIRM NATURAL UNDISTURBED SOIL OR CERTIFIED COMPACTED FILL. SOIL BEARING PRESSURE EQUAL TO 1500 PSF.
- THE MINIMUM REQUIREMENTS AND LOCAL FROST LINE REQUIREMENTS MAY SUPERSEDE THE DESIGN CALL OUTS. CONTACT THE LOCAL BUILDING DEPARTMENT FOR MINIMUM DEPTH REQUIREMENTS.

* BUILDINGS WITH SNOW LOADS ARE DESIGNED AS HEATED BUILDINGS

STEEL NOTES:

- ALL CONSTRUCTION TO COMPLY WITH THE LATEST EDITION OF THE OREGON STRUCTURAL SPECIALTY CODE, 2014 EDITION (2012 IBC) AND A.I.S.C.
- ALL MACHINE BOLTS TO COMPLY WITH A.S.T.M. A-307*. HOLES SHALL BE BOLT DIAMETER PLUS 1/16". (* UNLESS OTHERWISE NOTED)
- ALL HOT ROLLED OR COLD ROLLED SHEETS AND STRIPS USED IN THE FABRICATION OF COLD FORMED STRUCTURAL MEMBERS SHALL HAVE A MINIMUM YIELD STRENGTH OF 55 K.S.I.
- LIGHT GAGE - COLD FORMED STRUCTURAL STEEL MEMBERS SHALL CONFORM TO A.S.T.M. SPEC. A-500 GRADE "D" (Fy=50 K.S.I.), UNLESS OTHERWISE NOTED.
- ALL STRUCTURAL STEEL MEMBERS SHALL BE GALVANIZED.
- ROUND TUBES SHALL CONFORM TO A.S.T.M. SPEC. A-500 GRADE "D" (Fy=50K.S.I.).
- CABLES SHALL BE OF AIRCRAFT TYPE CABLE WITH THE FOLLOWING BREAKING STRENGTHS: 1/8" = 1,700 LBS., 3/16" = 4,200 LBS., 1/4" = 7,000 LBS.

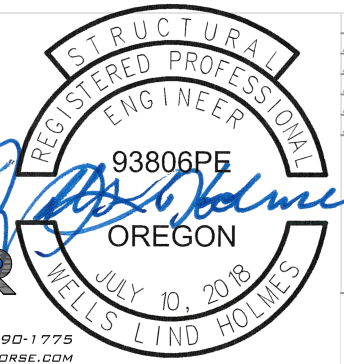

REVISIONS	
REVISION	
REVISION	
REVISION	
REVISION	
REVISION	

This document is CONFIDENTIAL and is the property of Euromex's Mfg. & Sales. This material shall not be used, copied or reproduced in whole or in part nor shall it be used in any manner without the written permission of Euromex's Mfg. & Sales.



DATE	10/18/2018
SCALE	NTS
JOB NO	JOB-JD
DRAWN BY	ARB
APPROVED	
TITLE	GREENHOUSE
ENGINEER	JOHNDAY
LOADING	ENG#
DRAWING NO.	LOADING
DRAWING SET	DWG-#
SHEET	SET1
OF	SET1
ADDRESS:	
COUNTRY:	USA
STATE:	OREGON
CITY:	JOHN DAY
Latitude:	44.42029 N
Longitude:	118.96716 W
CERTIFICATION	